

UNIVERSITY OF THE PHILIPPINES BAGUIO
Governor Pack Road, 2600 Baguio City

Bid Bulletin No. 1
April 12, 2021

**SUPPLY, DELIVERY, INSTALLATION AND COMMISSIONING OF
ONE (1) UNIT GENERATOR SET**

Bid Reference No. UPB-BID-2021-3

Issued pursuant to Sec. 22.5 of the IRR of R.A. 9184 to clarify and/or amend certain provisions in the Bidding Documents issued for this project, in response to bidders' written queries received within the prescriptive period for filing.

A. AMENDMENT/INCLUSION

LOCATION	ORIGINAL INSTRUCTIONS	AMENDMENT/ INCLUSION	REASON FOR AMENDMENT
Section III. Instructions to Bidders Clause 5.3	For this purpose, contract similar to the Project shall be: Experience in supply, delivery, installation and commissioning of generator set	For this purpose, contract similar to the Project shall be: Experience in supply, delivery, installation and commissioning of a generator set <u>with at least 100 KVA capacity</u>	To clarify the required definition of similar project
Section VII. Technical Specifications	1500rpm @ 80% Power Factor	1500rpm <u>1800rpm</u> @ 80% Power Factor	To correct the required REVOLUTIONS PER MINUTE
	Lay-out/plans not provided	Lay-out/Plan and picture of the power house is attached to this bid bulletin	To provide general view of the orientation and design of the existing power house

B. CLARIFICATION

CONCERN	REFERENCE	CLARIFICATION/ RESOLUTION
Regarding the Single Largest Completed Contract, the Bidding Documents in ITB Clause 5.3 states that we must have a similar project to the one to be bid. Does that mean we can declare any project as long as the project includes a generator set in its Bill of Quantities	Email from GEGA Engineering and Construction	A project which includes a generator set in its Bill of Quantities can be considered, provided that the capacity of the generator is at least 100KVA

For the SLCC's attachments, the bidding document states that we should have the following: <u>1. Contract</u> <u>2. Certificate of Completion</u> <u>3. Certificate of Acceptance</u> . However, we have not yet received the certificate of acceptance. What other alternatives can we submit as replacement or substitute for the certificate of acceptance?	Email from GEGA Engineering and Construction	In lieu of Certificate of Acceptance, the official receipt (OR) or sales invoice (SI) issued for the contract is acceptable.
--	--	--

By Rules, all other related provisions in the Bidding Documents correspondingly affected by these amendments are likewise deemed amended to conform to this Bid Bulletin. Amendments made herein shall be considered an integral part of the Bidding Document.






Chairperson, BAC

Attachments:

Three (3) Pictures

Two (2) Lay-out/plans

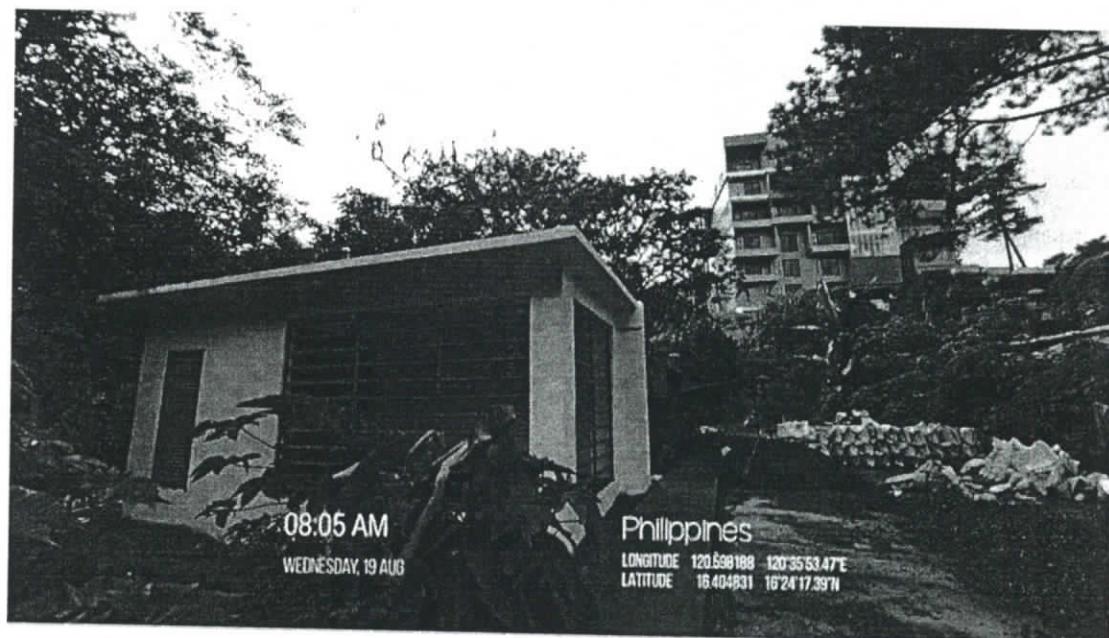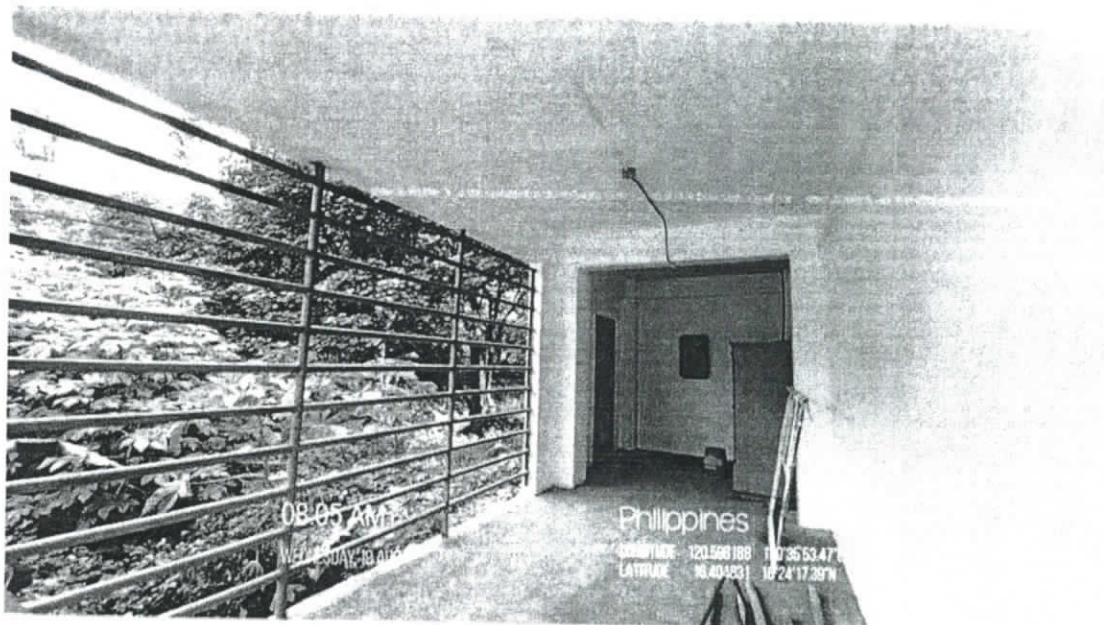

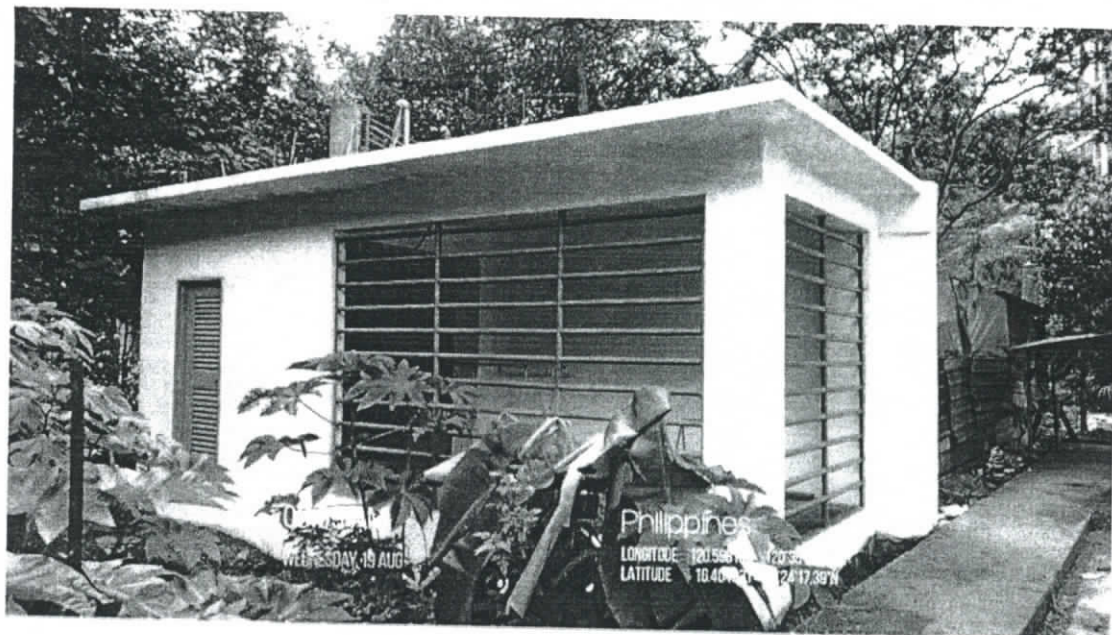


WEDNESDAY 19 AUG

Philippines


LONGITUDE 120°58' E 120°58'

LATITUDE 10°45' N 10°47'39" N

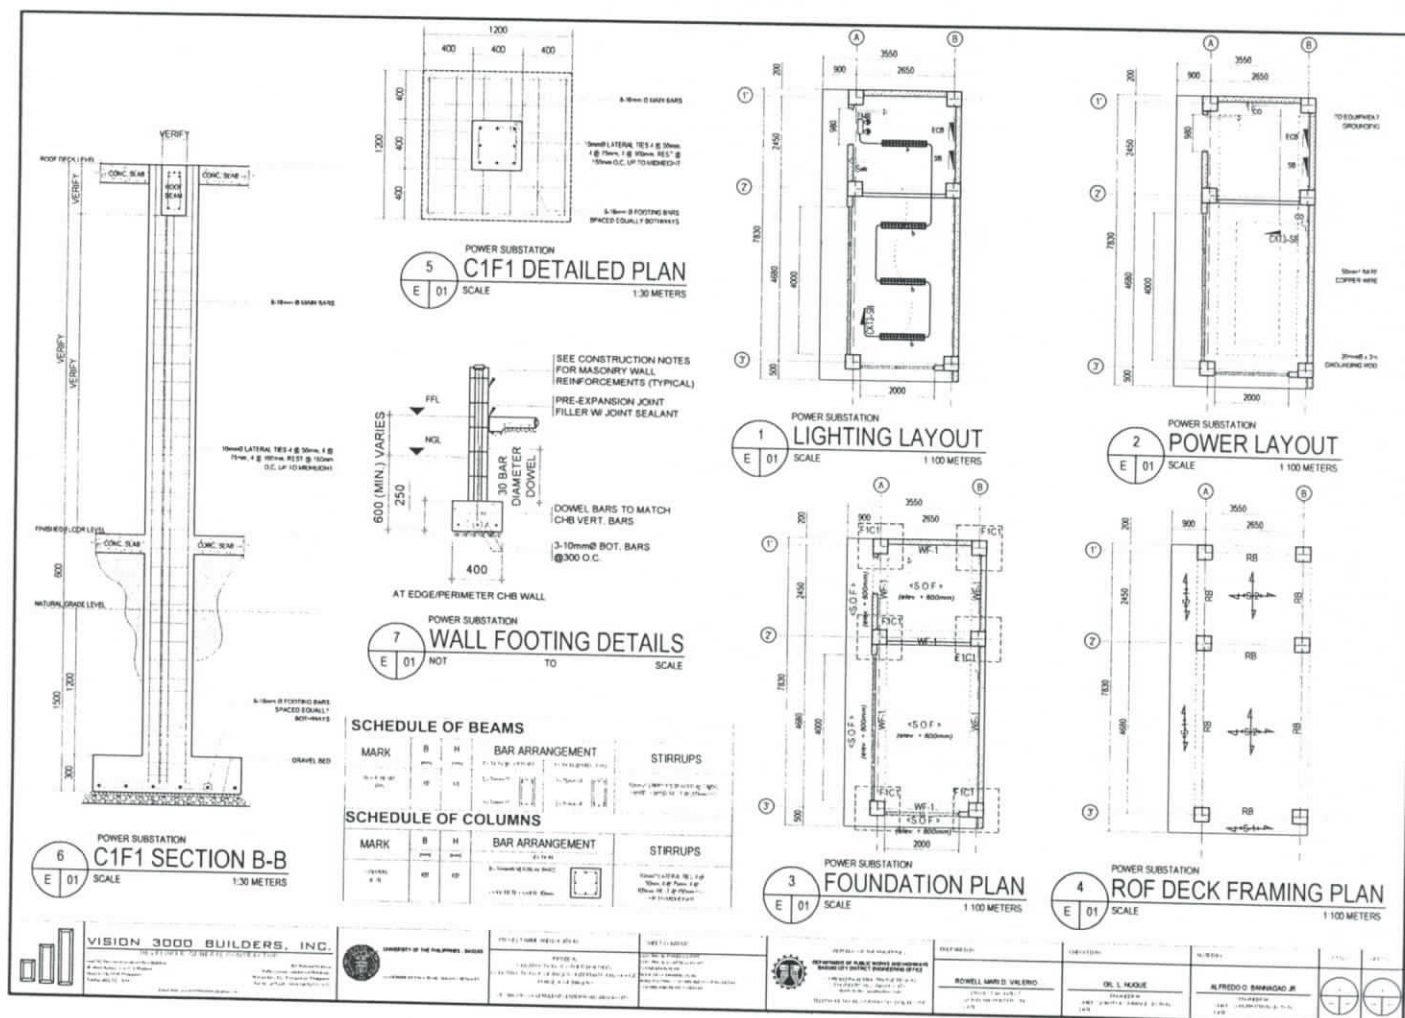



1 3.0 POWER SUBSTATION LIGHTING LAYOUT

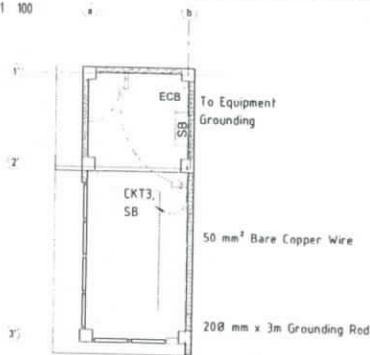

2 3.0 POWER SUBSTATION POWER LAYOUT

BENECO
MEDIUM VOLTAGE
23 KV

PCP

1. A
FUSE CUT-OUT
3 - 75 KVA POLE MOUNTED, SINGLE PHASE
TRANSFORMER, 23 KV/400DELTA/230Y, 60 HZ
3-200 mm² THHN (H) 1 - 50 mm² TW (G)
in 100 mm RSC Conduit

FCB
400AT

MDP

LVSG



G

250 KVA, 3 PHASE, 400V, 60 HZ
GENERATOR DIESEL SET

SINGLE LINE DIAGRAM

1 : 250

ROOF LEVEL
DPL4
LEVEL 4
DPL3
LEVEL 3
DPL2
LEVEL 2
DPL15
LEVEL 15
DPL1
LEVEL 1
DPL0
LEVEL 0
DPL0.5
LEVEL 0.5
DPL-1
LEVEL -1

	UNIVERSITY OF THE PHILIPPINES - DILIMAN	APPROVED FOR THE PROJECT: 3.0 POWER SUBSTATION DESIGNER: [Name] DATE: [Date]	PROJECT: 3.0 POWER SUBSTATION DESIGNER: [Name] DATE: [Date]	DESIGNER: [Name] DATE: [Date]		REVISIONS:	REVISIONS:	REVISIONS:	REVISIONS:	REVISIONS:	REVISIONS:
	DEPARTMENT OF ELECTRICAL ENGINEERING UNIVERSITY OF THE PHILIPPINES - DILIMAN	SUBSTATION LIGHTING & POWER LAYOUT - 3.0 POWER SUBSTATION	REVISIONS:	REVISIONS:		REVISIONS:	REVISIONS:	REVISIONS:	REVISIONS:	REVISIONS:	REVISIONS: